

DOCUMENT 00 90 00
ADDENDUM

ADDENDUM No.: 2

DATE: February 24, 2026

RE: WESTERN TECHNICAL COLLEGE
KUMM CENTER STUDENT UNION REMODEL
400 N. 6TH STREET
LA CROSSE, WISCONSIN 54601

PROJECT No.: 25041

FROM: HSR Associates, Inc
100 Milwaukee Street
La Crosse, WI 54603
(608) 784-1830

TO: Prospective Bidders

This addendum forms a part of the Contract Documents and modifies the original Bidding Documents dated February 2026. Acknowledge receipt of this Addendum in the space provided on the bid form. Failure to do so may subject the Bidder to disqualification.

This Addendum consists of: 2 pages, 1 document, 0 sections, and 5 drawings.

PRE-BID MEETING SIGN IN SHEET:

1. Pre-Bid Meeting Sign-In Sheet February 18, 2026

CHANGES TO DRAWINGS

2. Sheet A090 DEMOLITION PLAN 30"x42"
 - a. See the revised sheet included in this addendum. Disregard the previous version.
 - b. Keynote 18 updated.

3. Sheet ED02 ELECTRICAL POWER AND LOW VOLTAGE REMOVAL PLAN 30"x42"
 - a. See the revised sheet included in this addendum. Disregard the previous version.
 - b. Refer to Vestibule #101 and Corridor #102;
 - i. Disconnect Two (2) existing motorized door openers for removal by others on existing doors. Please note, existing motorized door openers to be removed and a new replacement door openers to be installed on same existing doors. Reuse existing branch-circuit wiring and low voltage control wiring and paddle type switches for replacement door openers. Coordinate with General Contractor and visit site to determine scope of work prior to submitting bid.

4. Sheet E100 ELECTRICAL LIGHTING PLAN 30"x42"
 - a. See the revised sheet included in this addendum. Disregard the previous version.
 - b. Refer to Offices #104A, #104B, #104C, #104D, #104F, #104G, #104H and #106;
 - i. Change light fixture type from AD4 to AD5S. Please note this lighting fixture will change from 5,000 lumens to 6,000 lumens.

5. Sheet E200 POWER PLAN 30"x42"
 - a. See the revised sheet included in this addendum. Disregard the previous version.
 - b. Refer to Vestibule #101 and Corridor #102;
 - i. Reconnect Two (2) new replacement motorized door openers and associated low voltage control switches on existing doors. Please note, Two (2) motorized door openers were previously disconnected for removal and Two (2) new replacement motorized door openers were installed on existing doors. Reuse existing branch-circuit wiring, low voltage wiring and paddle type control switches. Coordinate with General Contractor, field verify existing conditions prior to submitting bid to determine scope of work.

6. Sheet E500 ELECTRICAL SCHEDULES 30"x42"
 - a. See the revised sheet included in this addendum. Disregard the previous version.
 - b. Refer to Lighting Fixture Schedule;
 - i. Type AD5S lighting fixture was added to Lighting Fixture Schedule.

END OF DOCUMENT 00 90 00

SIGN-IN SHEET

**PLEASE PRINT ALL
INFORMATION CLEARLY**

PROJECT: WTC KUMM CTR STUDENT UNION REMODEL

HSR NO.: 25041 DATE: 2/18/2026

NAME	COMPANY	E-MAIL ADDRESS	TELEPHONE
Alyssa Frank	HSR Associates	afrank@hsrassociates.com	608.784.1830
Brandy Ernst	HSR	bernst@hsrassociates.com	" "
Gene Mcurdy	WTC		
Matt Meyer	Wieser Brothers	estimating@wieserbrothers.com	507 895 8903
MIKE AUVEN	Fowler & Hammer	bids@fowlerhammer.com	608-782-6849
Tyler Richling	Fowler & Hammer	"	"
Reed Willadsen	Kish Electric	bids@kishelectric.com	608-863-6485
Cotton Pahnke	Hoef Builders	CPahnke@hoefbuilders.com	715-495-6055
Josiah Hansons	Hoef Builders	Josiah@hoefbuilders.com	715-442-8067
Eric Prieur	Builders Flooring	eprieur@buildersflooringinc.net	608-792-5844
Fernando Lobato	WHV	FLOBATO@WHVR.COM	608-397-3016
Sam Furtak	Market + Johnson	bidding@market-johnson.com	608-784-5000
Jason Belter	Lirelme Sprinkler	Jason.belter@lirelmesprinkler.com	608-864-0257
Rick Twissan	Pye Baker Fire	Rick.Twissan@pyebakerfire.com	507 358 0645
Mac Smith	B+B Electric	msmith@b-belectricinc.com	715-492-9427
Bob Von Rueda	HJ Martin	b.vonrueden@hjmartin.com	608 606 0150
Tom Christman	LVC Companies	tchristman@LVCINC.COM	715 450-7497
Chris Helgerson	Bernie Buchner	chrishelgerson@BernieBuchnerInc.com	608-667-0028
Bart Greiner	JFAhern	bgreiner@jfahern.com	715-210-0964

Page Intentionally Left Blank



Consultant:

DEMOLITION GENERAL NOTES:

- A. ALL ITEMS SHOWN DASHED ON DEMOLITION PLANS SHALL BE REMOVED FROM THE SITE UNLESS OTHERWISE NOTED. REFERENCE MEP DRAWINGS FOR APPLICABLE EQUIPMENT REMOVALS AND MODIFICATIONS. COORDINATE PATCHING AT EQUIPMENT REMOVALS.
- B. AT WALL TYPES/MATERIALS, PREPARATION FOR NEW FINISHES SHALL INCLUDE, BUT NOT BE LIMITED TO REMOVAL OF EXISTING FINISHES, TAPES, GLUES/MASTIC, NAILS AND RELATED ITEMS. PATCHING OF HOLES, INDENTATIONS AND CRACKS FOR AN ACCEPTABLE SURFACE FOR NEW FINISH INSTALLATION.
- C. OWNER WILL REMOVE LOOSE FURNISHINGS AND EQUIPMENT FROM THE WORK AREA PRIOR TO START OF CONSTRUCTION.
- D. MAINTAIN ALL EXIT DOORS AND CORRIDORS IN UNOBSTRUCTED OPERABLE CONDITION WITH SAFE PASSAGE AWAY FROM THE BUILDING.
- E. ROOM NUMBERS ARE SHOWN ON THIS PLAN FOR INFORMATIONAL AND COORDINATION PURPOSES ONLY.
- F. COORDINATE STORAGE LOCATIONS FOR SALVAGED ITEMS WITH OWNER.
- G. PROVIDE FLOOR PROTECTION AS SPECIFIED AT DEBRIS REMOVAL PATHS THROUGH BUILDING.

DEMOLITION PLAN LEGEND:

- SYMBOL INDICATES CONSTRUCTION NOTE THIS SHEET
- REMOVE ITEMS NOTED WITH DASHED LINES
- SYMBOL INDICATES REMOVAL OF DOOR AND FRAME UNLESS NOTED OTHERWISE

KEY NOTES DEMOLITION

- 1 REMOVE MASONRY WALL TO EXISTING B.O. STONE - 12'-0" +/- AFF.
- 2 REMOVE STUD PARTITION
- 3 REMOVE STUD PARTITION AND BOOTHS
- 4 REMOVE DOOR AND FRAME, INCLUDING SIDELIGHT AND TRANSOM WINDOW WHERE APPLICABLE. ALL LOCKSETS TO BE SALVAGED BACK TO OWNER.
- 5 REMOVE CASEWORK AND COUNTERTOP
- 6 REMOVE ACCT CEILING
- 7 REMOVE WOOD TILE CEILING
- 8 REMOVE GYP BD BULKHEAD, CEILING, AND FRAMING
- 9 REMOVE LINEAR METAL CEILING
- 10 MODIFY EXISTING CEILING GRID AND TILES AS REQUIRED FOR NEW LAYOUT.
- 11 REMOVE OPT FLOORING
- 12 REMOVE LVT FLOORING
- 13 MODIFY EXISTING FLOORING AS REQUIRED FOR NEW LAYOUT.
- 14 REMOVE TRIM, SHELVING, AND BUILT-IN CASEWORK - PATCH AND PAINT - SEE 61410.
- 15 REMOVE ELECTRICAL COVER PLATE - PATCH AND PAINT - SEE 61410.
- 16 REMOVE RESTROOM STALL PARTITIONS. PATCH AND REPAIR ALL FINISH PARTS OF CONSTRUCTION.
- 17 PORTABLE STAGE TO BE REMOVED AND SALVAGED BY OWNER
- 18 REMOVE PORTABLE FURNITURE PARTITIONS
- 19 EXISTING SPEAKERS TO BE REMOVED AND REINSTALLED BY OWNER
- 20 EXISTING WALL MOUNTED MONITOR TO BE REMOVED AND REINSTALLED BY OWNER
- 21 EXISTING PROJECTOR TO BE REMOVED AND REINSTALLED BY OWNER
- 22 EXISTING FURNITURE PHONE BOOTH TO BE REMOVED AND REINSTALLED BY OWNER
- 23 EXISTING ATM TO BE REMOVED AND REINSTALLED BY OWNER
- 24 EXISTING VENDING TO BE REMOVED AND REINSTALLED BY OWNER
- 25 SAW CUT FLOOR FOR NEW FOLDING PARTITION FLOOR TRACK
- 26 SAW CUT FLOOR AT EXISTING CONDUIT FOR NEW FLOOR OUTLET - SEE ELECTRICAL.
- 27 ALTERNATE: CORE DRILL FLOOR NEW FLOOR OUTLET - SEE ELECTRICAL.
- 28 GRIND TERRAZZO EDGE FOR SMOOTH ELEVATION CHANGE UNDER NEW FLOOR FINISH.



1 DEMOLITION PLAN
3/16" = 1'-0"



WESTERN TECHNICAL COLLEGE
KUMM CENTER STUDENT UNION REMODEL

Project Title:

HSR Project Number:

25041

Project Date:

FEBRUARY 2026

Drawn By:

HSR

Key Plan:

Revisions:

No.	Description	Date
A02	Addendum 2	02/24/2026

Graphic Scale:

Last Update:

2/24/2026 11:28:52 AM

Sheet Title:

Project Location: 400 6th St N
La Crosse WI 54601

DEMOLITION PLAN

A090



PHOTO #1



PHOTO #2



PHOTO #3



PHOTO #4


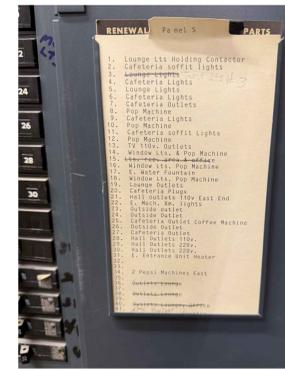


PHOTO #5



PHOTO #6

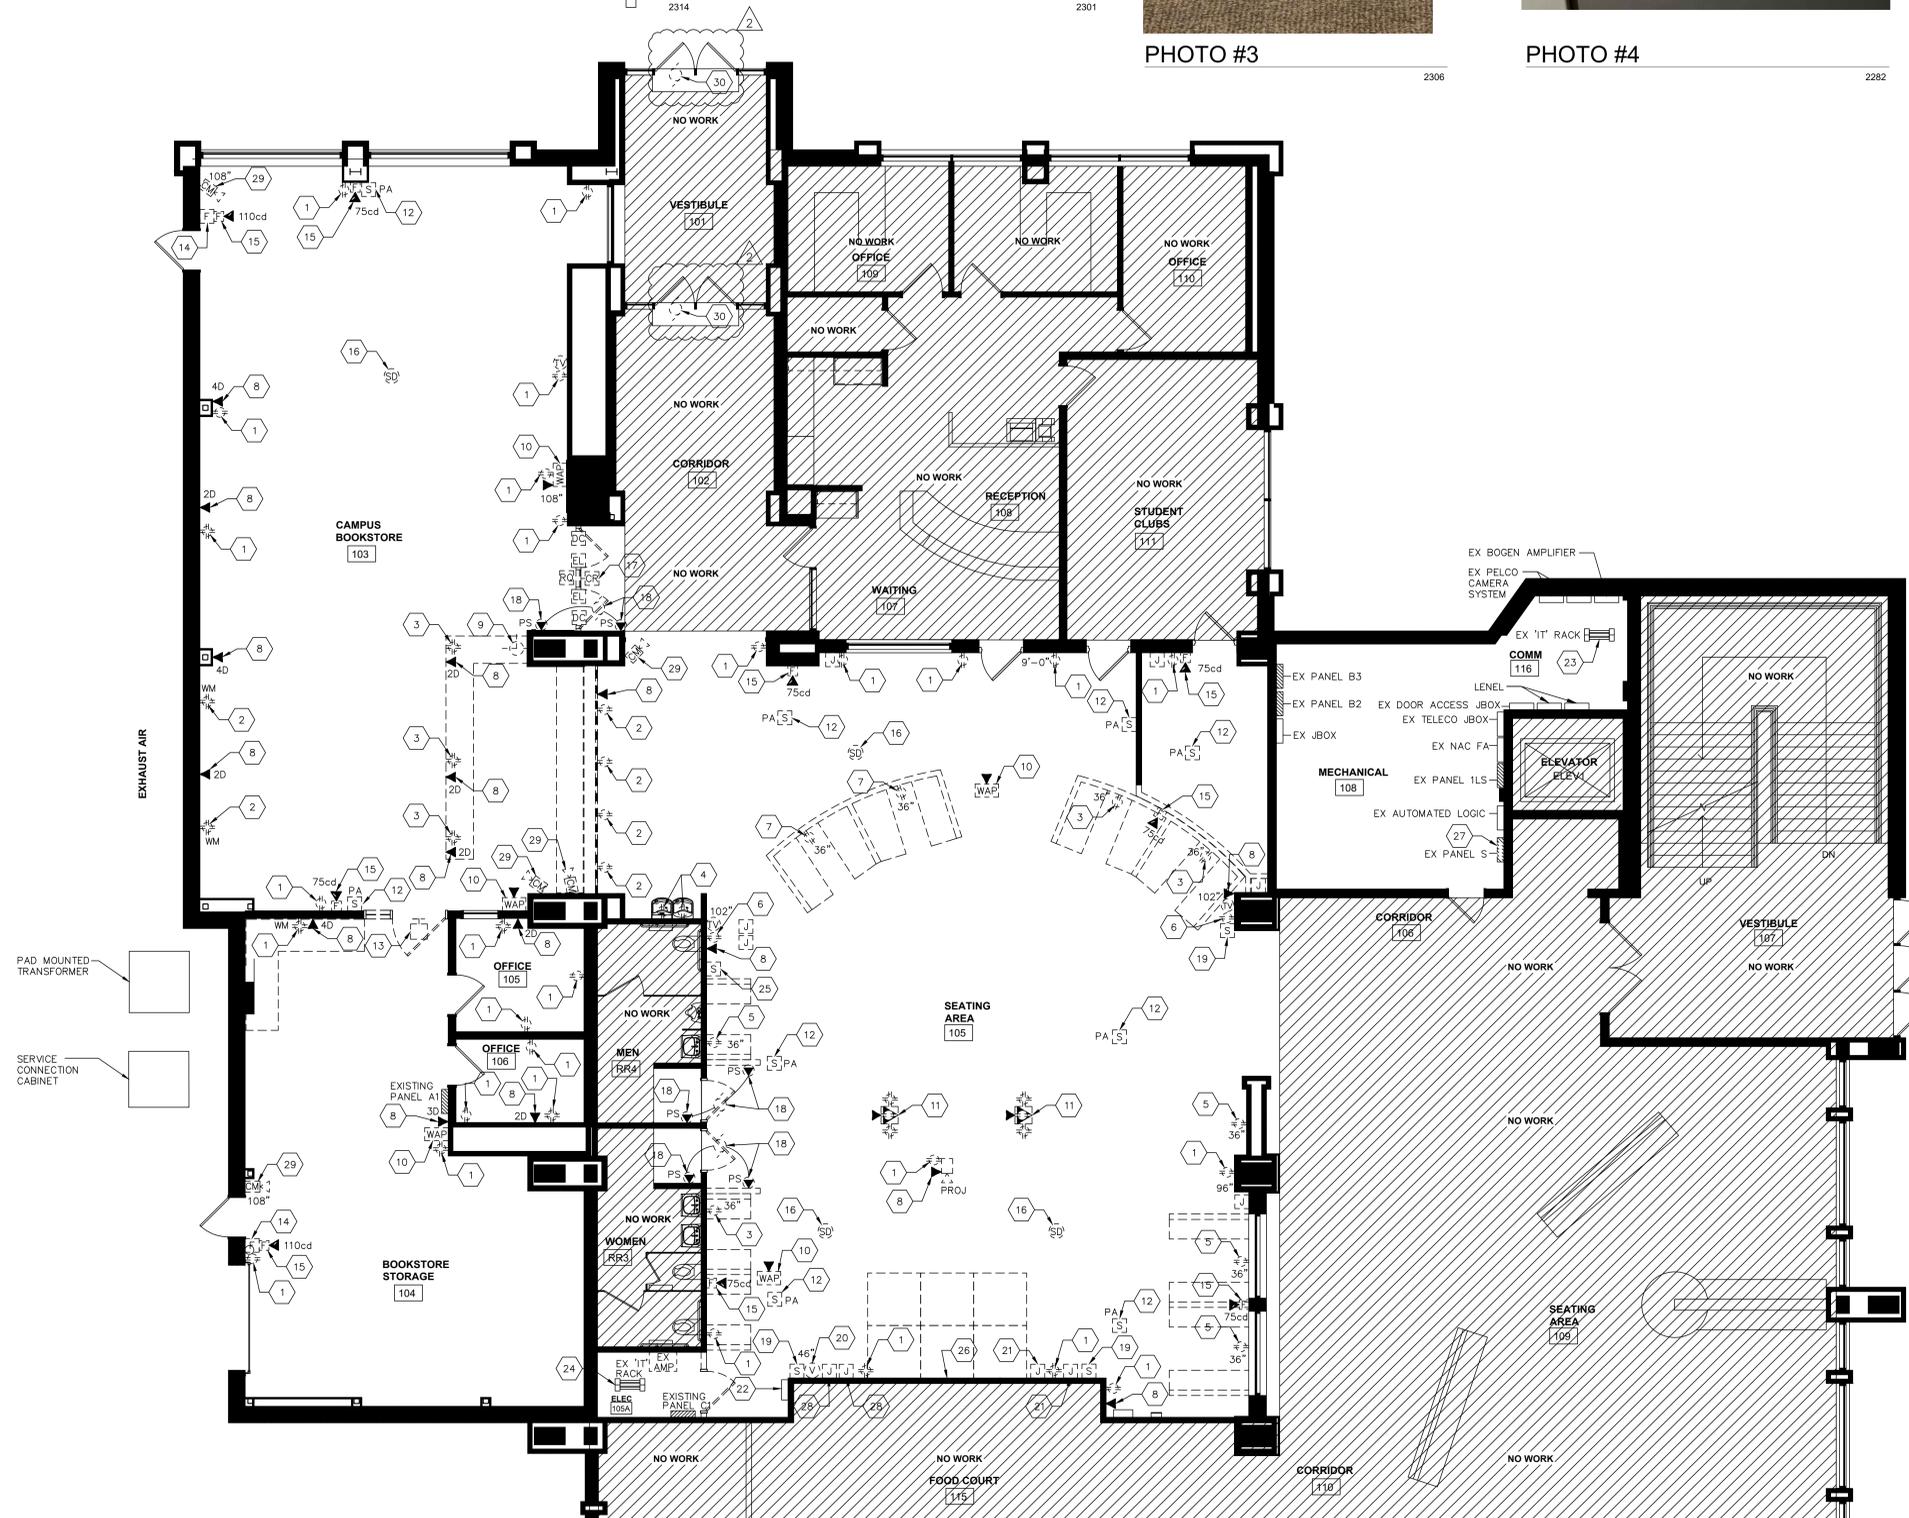

- GENERAL REMOVAL NOTES:**
- DEMOLITION NOTES AND SYMBOLS ARE BASED UPON EXISTING DRAWINGS AND CASUAL OBSERVATION OF BUILDING AND DOES NOT INCLUDE A COMPLETE LIST OF DEMOLITION ITEMS.
 - RECOMMEND ELECTRICAL CONTRACTOR VISIT EXISTING SITE TO DETERMINE SCOPE OF WORK PRIOR TO SUBMITTING BID.
 - NO EXISTING ELECTRICAL ITEMS REMOVED SHALL BE REUSED FOR THIS PROJECT UNLESS NOTED OTHERWISE.
 - IT SHALL BE ALLOWED TO REUSE ALL EXISTING JUNCTION BOXES, CONDUIT, STRAPS, BRANCH-CIRCUIT WIRING AND SWITCH-LEG WIRING TO THE EXTENT POSSIBLE. IT IS **NOT** ALLOWED TO REUSE EXISTING LOW VOLTAGE WIRING UNLESS APPROVED BY WTC IT DEPARTMENT.
- KEYED ELECTRICAL REMOVAL PLAN NOTES POWER AND LOW VOLTAGE - ED02:**
- DISCONNECT, REMOVE AND DISPOSE OF EXISTING DUPLEX RECEPTACLE(S). REUSE EXISTING BRANCH-CIRCUIT WIRING, JUNCTION BOXES, CONDUIT, ETC. TO THE EXTENT POSSIBLE FOR REMODEL WORK.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING SURFACE 'WIREMOLD' RACEWAY AND RECEPTABLES. REMOVE WIRING BACK TO SOURCE, DO NOT REUSE OR ABANDON IN PLACE.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING DUPLEX RECEPTACLE(S). REMOVE EXISTING BRANCH-CIRCUIT WIRING, CONDUIT, JUNCTION BOXES, ETC. BACK TO SOURCE.
 - EXISTING DUPLEX RECEPTACLE TO REMAIN AS IS FOR WATER COOLER. FIELD VERIFY RECEPTACLE IS GFCI PROTECTED. IF THE RECEPTACLE IS NOT GFCI PROTECTED PROVIDE A GFCI CIRCUIT BREAKER FEEDING THIS BRANCH-CIRCUIT OR PROVIDE A GFCI DUPLEX RECEPTACLE.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING DUPLEX RECEPTACLE(S). REUSE EXISTING BRANCH-CIRCUIT WIRING, JUNCTION BOXES, CONDUIT, ETC. TO THE EXTENT POSSIBLE FOR REMODEL WORK. HOWEVER, IT WILL BE REQUIRED TO LOWER THIS RECEPTACLE TO 18" ABOVE FINISHED FLOOR.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING DUPLEX RECEPTACLE(S). REUSE EXISTING BRANCH-CIRCUIT WIRING, JUNCTION BOXES, CONDUIT, ETC. TO THE EXTENT POSSIBLE FOR REMODEL WORK. PLEASE NOTE THIS RECEPTACLE IS LOCATED HIGH ON THE WALL AND USED FOR WALL MOUNTED INFORMATION MONITOR.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING WALL TO BE DEMOLISHED. HOWEVER IT IS DESIRED TO INSTALL A FLOOR BOX IN THE LOCATION WHERE THE CONDUIT RISES ABOVE CONCRETE FLOOR TO FEED RECEPTACLE. IT WILL BE REQUIRED TO SAWCUT EXISTING CONCRETE FLOOR TO INSTALL NEW FLOOR BOX. REFER TO SHEET E200 FOR ADDITIONAL INFORMATION.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING DATA JACKS. REMOVE LOW VOLTAGE WIRING BACK TO SOURCE LOCATED IN COMM ROOM #116. DO NOT ABANDON IN PLACE OR REUSE. IT SHALL BE ALLOWED TO REUSE EMPTY CONDUIT, JUNCTION BOXES, ETC. FOR NEW DATA JACKS TO BE INSTALLED IN SAME LOCATION. COORDINATE THOROUGHLY WITH WTC IT DEPARTMENT.
 - DISCONNECT, REMOVE AND SALVAGE EXISTING CLOCK TO OWNER. DISCONNECT, REMOVE ASSOCIATED BRANCH-CIRCUIT WIRING BACK TO SOURCE.
 - DISCONNECT, REMOVE AND SALVAGE EXISTING WIRELESS ACCESS POINT TO WTC IT DEPARTMENT. REMOVE LOW VOLTAGE WIRING BACK TO SOURCE LOCATED IN COMM ROOM #116. DO NOT ABANDON IN PLACE OR REUSE. TYPICAL.
 - EXISTING FLOOR BOX TO REMAIN AS IS. HOWEVER THE DATA JACKS WILL NO LONGER BE USED. REMOVE LOW VOLTAGE WIRING BACK TO SOURCE IF REASONABLE TO DO SO. IT WILL BE REQUIRED TO PROVIDE NEW FLOOR BOX COVERS. THE EXISTING COVER PLATE HAS BEEN DAMAGED TO OVERLIE. COORDINATE WITH 'WIREMOLD' REPRESENTATIVE FOR EXACT MODEL NUMBER FOR REPLACEMENT. COORDINATE WITH WTC FACILITY DEPARTMENT. REFER TO PHOTO #1/ED02.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING PUBLIC ADDRESS SYSTEM SPEAKER. REMOVE ASSOCIATED LOW VOLTAGE WIRING BACK TO SOURCE, DO NOT REUSE OR ABANDON IN PLACE. PLEASE NOTE P.A. AMPLIFIER IS LOCATED IN COMM ROOM #116. TYPICAL.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING DOORBELL SYSTEM. REMOVE ASSOCIATED LOW VOLTAGE WIRING BACK TO SOURCE. DO NOT ABANDON IN PLACE OR REUSE.
 - EXISTING MANUAL FIRE ALARM SYSTEM PULL STATION TO REMAIN AS IS.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING WALL MOUNTED 'EST' FIRE ALARM SYSTEM NOTIFICATION DEVICE. PROVIDE A BLANK COVER PLATE FOR JUNCTION BOX. IT SHALL BE ALLOWED TO REUSE EXISTING FIRE ALARM SYSTEM WIRING TO THE EXTENT POSSIBLE FOR NEW REMODEL WORK.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING CEILING MOUNTED 'EST' FIRE ALARM SYSTEM SMOKE DETECTOR. IT SHALL BE ALLOWED TO REUSE EXISTING FIRE ALARM SYSTEM WIRING TO THE EXTENT POSSIBLE FOR NEW REMODEL WORK.
 - DISCONNECT, REMOVE AND REINSTALL DOOR ACCESS CARD READER, DOOR CONTACTS, REQUEST TO EXIT AND ELECTRIC LOCK FOR NEW DOOR PROVIDED AS A REPLACEMENT. REUSE EXISTING DOOR ACCESS CONTROL WIRING TO THE EXTENT POSSIBLE. PLEASE NOTE 'LENEL' DOOR ACCESS CONTROL PANELS ARE LOCATED IN COMM ROOM #116.
 - PLEASE NOTE EXISTING DOOR SHALL BE REMOVED AND REPLACED WITH NEW. DISCONNECT EXISTING MOTORIZED DOOR OPENER AND PUSH BUTTON(S) FOR DOOR OPENER AND RECONNECT TO NEW MOTORIZED DOOR OPENER FOR NEW REPLACEMENT DOOR. REUSE EXISTING LOW VOLTAGE CONTROL WIRING AND BRANCH-CIRCUIT WIRING TO THE EXTENT POSSIBLE. COORDINATE WITH GENERAL CONTRACTOR.
 - EXISTING A/V SYSTEM AUDIO SPEAKER TO REMAIN AS IS. PLEASE NOTE A/V SYSTEM EQUIPMENT RACK LOCATED IN ELECTRICAL ROOM #105A.
 - DISCONNECT, REMOVE AND DISPOSE OF EXISTING VOLUME CONTROL SWITCH. REMOVE EXISTING JUNCTION BOX. GENERAL CONTRACTOR SHALL REPAIR, PATCH AND PAINT WALL. REMOVE LOW VOLTAGE WIRING BACK TO SOURCE, DO NOT ABANDON IN PLACE.
 - DISCONNECT, REMOVE AND REINSTALL EXISTING A/V SYSTEM LOW VOLTAGE JACKS AS NOTED ON SHEET E300. THE INTENT IS TO REMOVE EXISTING A/V JACKS AND REINSTALL IN NEW LOCATION AS NOTED ON SHEET E300. REFER TO PHOTOS #2/ED02 & #3/ED02.
 - DISCONNECT, REMOVE AND REINSTALL EXISTING A/V SYSTEM TOUCH PAD CONTROL PANEL TO NEW SEATING AREA. REFER TO SHEET E300 FOR LOCATION. COORDINATE WITH WTC IT DEPARTMENT. REFER TO PHOTO #4/ED02.
 - LOCATION OF EXISTING COMMUNICATION EQUIPMENT RACK. IT WILL BE REQUIRED TO UPDATE EXISTING RACK WITH CAT5A DATA PATCH PANELS FOR NEW DATA JACKS TO BE INSTALLED. COORDINATE WITH WTC IT DEPARTMENT. REFER TO PHOTO #5/ED02.
 - LOCATION OF EXISTING A/V EQUIPMENT RACK. REFER TO PHOTO #1/E300.
 - DISCONNECT, REMOVE AND SALVAGE EXISTING AUDIO WALL SPEAKER FOR REINSTALLATION AS NOTED ON SHEET E300. PLEASE NOTE A/V EQUIPMENT RACK LOCATED IN ELECTRICAL ROOM #105A.
 - ALL A/V JUNCTION BOXES ABANDONED ON THIS WALL SHALL BE REMOVED BY EC. THE WALL WILL NEED TO BE PATCHED AND PAINTED BY GENERAL CONTRACTOR. THIS WALL IS USED AS A VIDEO PROJECTION SCREEN WALL.
 - ELECTRICAL CONTRACTOR SHALL DISCONNECT, REMOVE AND DISPOSE OF EXISTING 'GENERAL ELECTRIC', 100AMP, 120/208VAC, 3-PHASE, 4-WIRE 42 SPACE, MAIN LUG ONLY PANELBOARD AND REPLACE WITH A NEW 125 AMP, 120/208VAC, 3-PHASE, 4-WIRE, MAIN LUG ONLY 'SQUARE D' NIG PANELBOARD. NO EQUALS ACCEPTED. INCLUDE AS ALTERNATE BID #1. REFER TO PHOTOS #5/ED02 AND #6/ED02. RECOMMEND FIELD OBSERVATION PRIOR TO SUBMITTING BID TO DETERMINE SCOPE OF WORK. REFER TO PANELBOARD SCHEDULE.
 - EXISTING A/V SYSTEM LOW VOLTAGE JACKS TO REMAIN AS IS. HOWEVER IT IS REQUIRED TO INSTALL A NEW 3-GANG COVER PLATE. REFER TO PHOTO #2/ED02. COORDINATE WITH WTC IT DEPARTMENT.
 - DISCONNECT, REMOVE AND SALVAGE EXISTING CAMERA TO WTC IT DEPARTMENT. REMOVE LOW VOLTAGE WIRING BACK TO COMM ROOM #116.
 - DISCONNECT EXISTING MOTORIZED DOOR OPENER AND PUSH BUTTON(S) FOR REMOVAL OF EXISTING DOOR OPENER AND RECONNECT TO NEW REPLACEMENT MOTORIZED DOOR OPENER FOR EXISTING DOOR. REUSE EXISTING LOW VOLTAGE CONTROL WIRING AND BRANCH-CIRCUIT WIRING TO THE EXTENT POSSIBLE. COORDINATE WITH GENERAL CONTRACTOR.

1 ELECTRICAL POWER & LOW VOLTAGE REMOVAL PLAN
3/16" = 1'-0"

ARCHITECTURE
ENGINEERING
INTERIOR DESIGN

HSR ASSOCIATES INC.
100 MILWAUKEE STREET
LA CROSSE, WISCONSIN
PHONE: 608.784.1830
FAX: 608.782.5844
www.hsrasociates.com

Consultant:

galileo CONSULTING
2405 SAND STREET 404 FT. H.
LA CROSSE, WISCONSIN 54601
PHONE: 608.784.1830
FAX: 608.782.5844
E-MAIL: galileo@galileo-consulting.com

WESTERN TECHNICAL COLLEGE
KUMM STUDENT UNION REMODEL

Project Title: WESTERN TECHNICAL COLLEGE
KUMM STUDENT UNION REMODEL

Project Location: 400 6th St. N.
La Crosse WI 54601

HSR Project Number: 25041

Project Date: FEBRUARY 2026

Drawn By: PLP

Key Plan:

Revisions:

No.	Description	Date
ADDENDUM # 2		02/24/26

Graphic Scale: VARIES

Last Update: 2/03/2026

ED02



HSR ASSOCIATES INC.
100 MILWAUKEE STREET
LA CROSSE, WISCONSIN
PHONE: 608.784.1830
FAX: 608.782.5844
www.hsrassociates.com

Consultant:



2405 SUNDY STREET, SUITE 101
LA CROSSE, WISCONSIN 54601
PHONE: 608.787.5875
EMAIL: info@galileoconsulting.com

Project Title: **WESTERN TECHNICAL COLLEGE
KUMM STUDENT UNION REMODEL**

Project Location: **400 6th St. N.
La Crosse WI 54601**

HSR Project Number: **25041**

Project Date: **FEBRUARY 2026**

Drawn By: **PLP**


Key Plan:

No.	Description	Date
ADDENDUM # 2		02/24/26

Graphic Scale: **VARIES**

Last Update: **2/03/2026**

E100

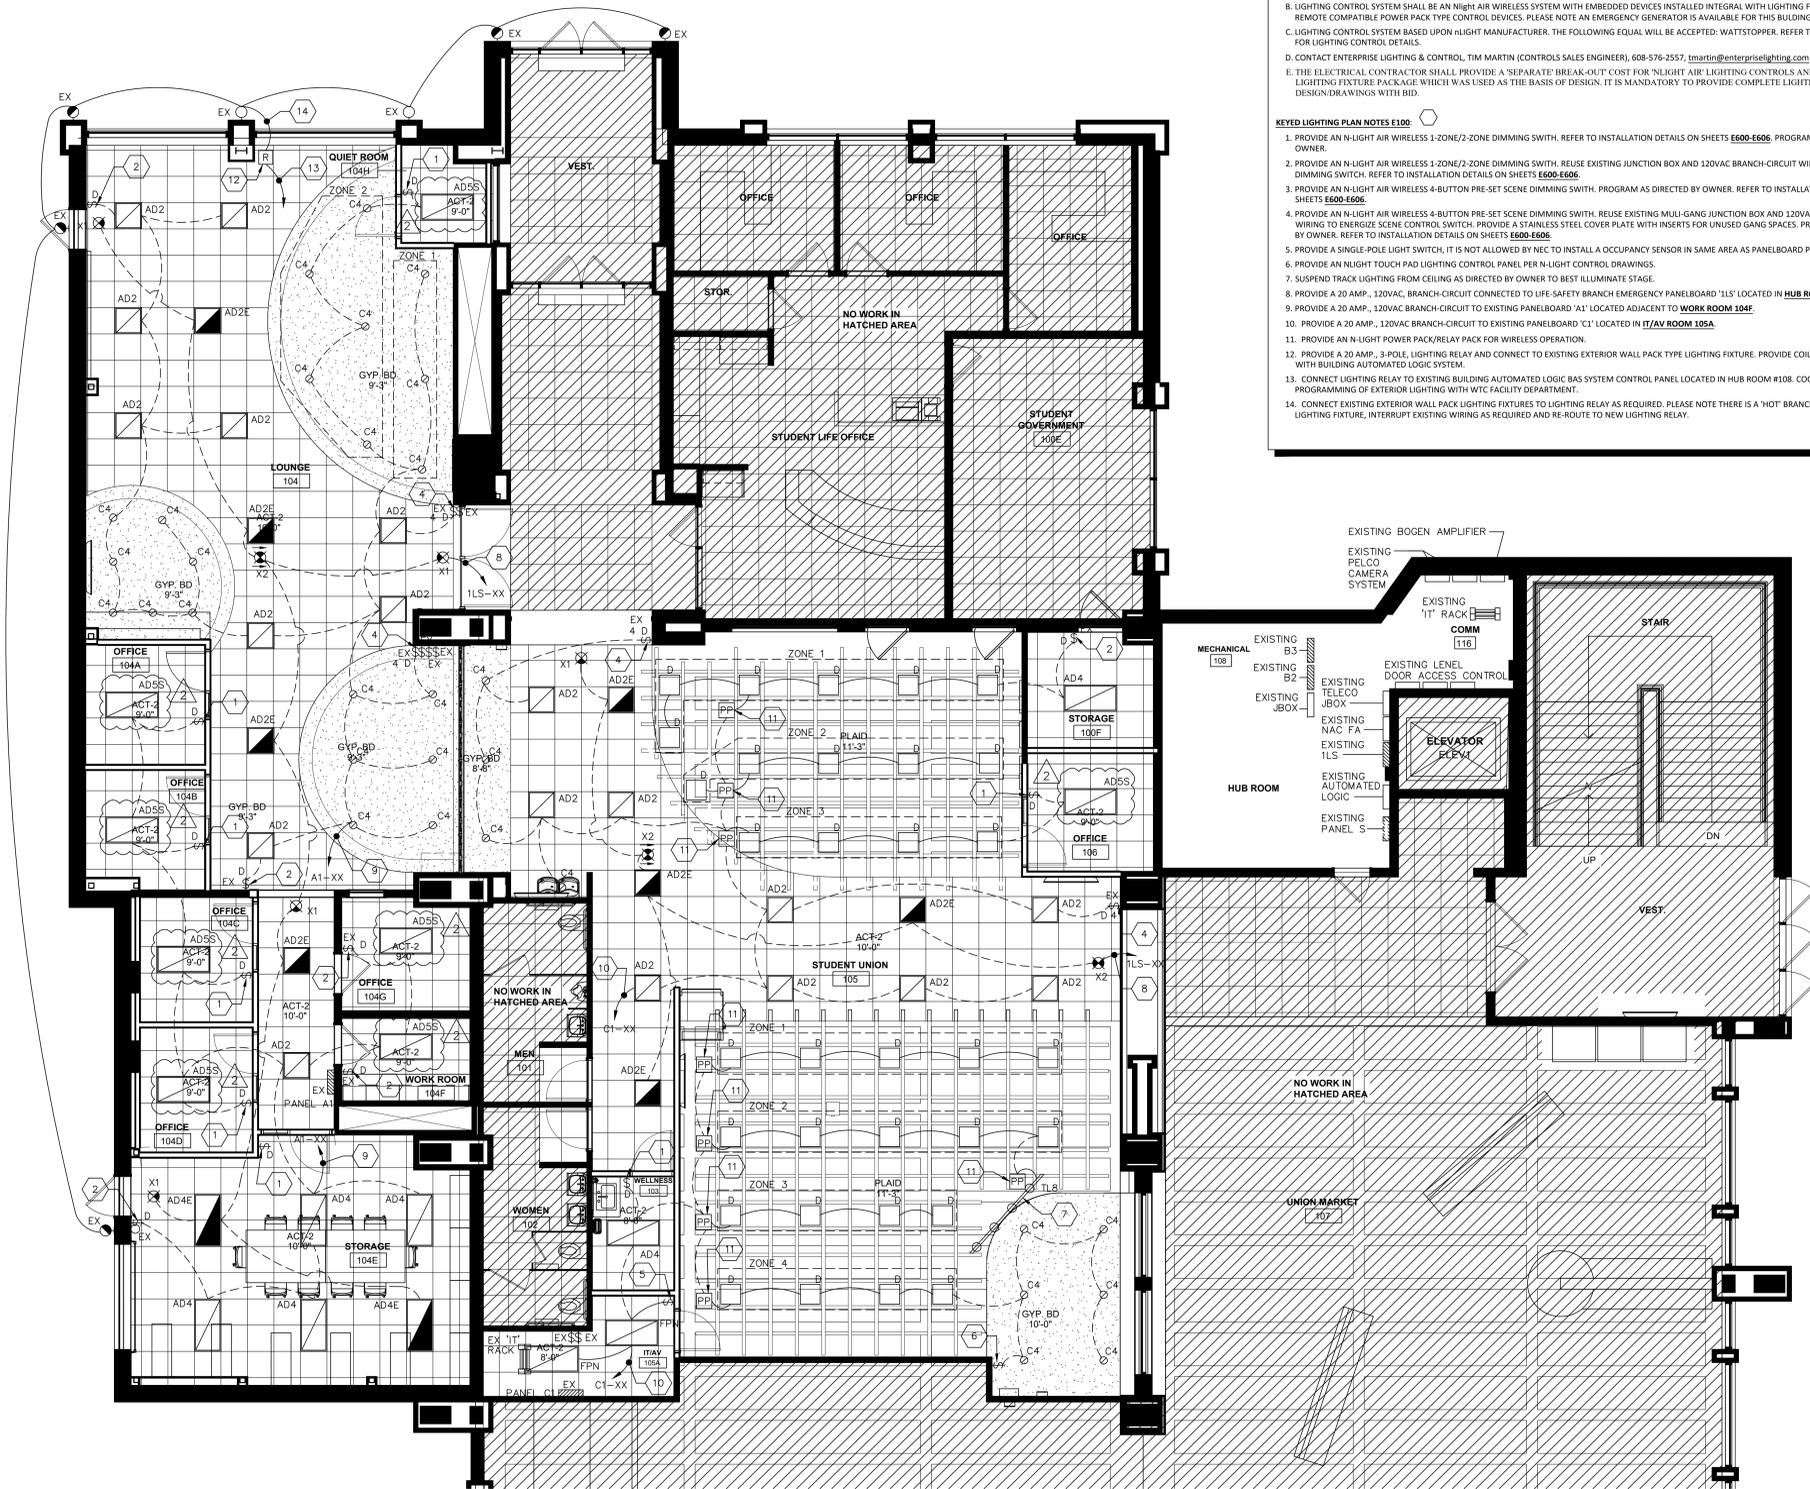

- GENERAL NOTES FOR LIGHTING:**
- FINAL NIGHT OCCUPANCY SENSOR LOCATION SHALL BE BY OCCUPANCY SENSOR MANUFACTURER.
 - LIGHTING CONTROL SYSTEM SHALL BE AN N-LIGHT AIR WIRELESS SYSTEM WITH EMBEDDED DEVICES INSTALLED INTEGRAL WITH LIGHTING FIXTURES OR WITH REMOTE COMPATIBLE POWER PACK TYPE CONTROL DEVICES. PLEASE NOTE AN EMERGENCY GENERATOR IS AVAILABLE FOR THIS BUILDING.
 - LIGHTING CONTROL SYSTEM BASED UPON H-LIGHT MANUFACTURER. THE FOLLOWING EQUAL WILL BE ACCEPTED: WATTSTOPPER. REFER TO SHEETS E600-E606 FOR LIGHTING CONTROL DETAILS.
 - CONTACT ENTERPRISE LIGHTING & CONTROL, TIM MARTIN (CONTROLS SALES ENGINEER), 608-576-2557, tmartin@enterprise-lighting.com
 - THE ELECTRICAL CONTRACTOR SHALL PROVIDE A SEPARATE BREAK-OUT COST FOR 'NIGHT AIR LIGHTING CONTROLS AND ENTERPRISE LIGHTING FIXTURE PACKAGE WHICH WAS USED AS THE BASIS OF DESIGN. IT IS MANDATORY TO PROVIDE COMPLETE LIGHTING CONTROLS DESIGN DRAWINGS WITH BID.
- KEYED LIGHTING PLAN NOTES E100:**
- PROVIDE AN N-LIGHT AIR WIRELESS 1-ZONE/2-ZONE DIMMING SWITCH. REFER TO INSTALLATION DETAILS ON SHEETS E600-E606. PROGRAM AS DIRECTED BY OWNER.
 - PROVIDE AN N-LIGHT AIR WIRELESS 1-ZONE/2-ZONE DIMMING SWITCH. REUSE EXISTING JUNCTION BOX AND 120VAC BRANCH-CIRCUIT WIRING TO ENERGIZE DIMMING SWITCH. REFER TO INSTALLATION DETAILS ON SHEETS E600-E606.
 - PROVIDE AN N-LIGHT AIR WIRELESS 4-BUTTON PRE-SET SCENE DIMMING SWITCH. PROGRAM AS DIRECTED BY OWNER. REFER TO INSTALLATION DETAILS ON SHEETS E600-E606.
 - PROVIDE AN N-LIGHT AIR WIRELESS 4-BUTTON PRE-SET SCENE DIMMING SWITCH. REUSE EXISTING MULTI-GANG JUNCTION BOX AND 120VAC BRANCH-CIRCUIT WIRING TO ENERGIZE SCENE CONTROL SWITCH. PROVIDE A STAINLESS STEEL COVER PLATE WITH INSERTS FOR UNUSED GANG SPACES. PROGRAM AS DIRECTED BY OWNER. REFER TO INSTALLATION DETAILS ON SHEETS E600-E606.
 - PROVIDE A SINGLE-POLE LIGHT SWITCH, IT IS NOT ALLOWED BY NEC TO INSTALL AN OCCUPANCY SENSOR IN SAME AREA AS PANELBOARD PANEL.
 - PROVIDE AN N-LIGHT TOUCH PAD LIGHTING CONTROL PANEL PER N-LIGHT CONTROL DRAWINGS.
 - SUSPEND TRACK LIGHTING FROM CEILING AS DIRECTED BY OWNER TO BEST ILLUMINATE STAGE.
 - PROVIDE A 20 AMP, 120VAC BRANCH-CIRCUIT CONNECTED TO LIFE SAFETY BRANCH EMERGENCY PANELBOARD '115' LOCATED IN HUB ROOM #108.
 - PROVIDE A 20 AMP, 120VAC BRANCH-CIRCUIT TO EXISTING PANELBOARD 'A1' LOCATED ADJACENT TO WORK ROOM 104F.
 - PROVIDE A 20 AMP, 120VAC BRANCH-CIRCUIT TO EXISTING PANELBOARD 'C1' LOCATED IN IT/AV ROOM 105A.
 - PROVIDE AN N-LIGHT POWER PACK/RELAY PACK FOR WIRELESS OPERATION.
 - PROVIDE A 20 AMP, 3-POLE LIGHTING RELAY AND CONNECT TO EXISTING EXTERIOR WALL PACK TYPE LIGHTING FIXTURE. PROVIDE COIL VOLTAGE COMPATIBLE WITH BUILDING AUTOMATED LOGIC SYSTEM.
 - CONNECT LIGHTING RELAY TO EXISTING BUILDING AUTOMATED LOGIC BAS SYSTEM CONTROL PANEL LOCATED IN HUB ROOM #108. COORDINATE PROGRAMMING OF EXTERIOR LIGHTING WITH WTC FACILITY DEPARTMENT.
 - CONNECT EXISTING EXTERIOR WALL PACK LIGHTING FIXTURES TO LIGHTING RELAY AS REQUIRED. PLEASE NOTE THERE IS A 'HOT' BRANCH-CIRCUIT AT EXTERIOR LIGHTING FIXTURE, INTERRUPT EXISTING WIRING AS REQUIRED AND RE-ROUTE TO NEW LIGHTING RELAY.

1 ELECTRICAL LIGHTING PLAN
3/16" = 1'-0"



HSR ASSOCIATES INC.
100 MILWAUKEE STREET
LA CROSSE, WISCONSIN
PHONE: 608.784.1830
FAX: 608.782.5844
www.hsrassociates.com

Consultant:



4040 SANDY STREET SUITE 101
LA CROSSE, WISCONSIN 54601
PHONE: 608.784.1830
FAX: 608.782.5844
www.galileoconsulting.com

Project Title: WESTERN TECHNICAL COLLEGE
KUMM STUDENT UNION REMODEL

Project Location: 400 6th St. N.
La Crosse WI 54601

Project Number: 25041

Project Date: FEBRUARY 2026

Drawn By: PLP

Key Plan:

Revisions:

No. Description Date

ADDENDUM # 2 02/24/26

Graphic Scale: VARIES

Last Update: 2/03/2026

Sheet Title:

Electrical Power Plans

3/16" = 1'-0"

3

BASEMENT PLAN

3/16" = 1'-0"

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE

3/16" = 1'-0"

2

NO WORK IN HATCHED AREA

VEST.

36

2

90°

SW VESTIBULE



Consultant:



2405 SAND STREET SUITE 110
LA CROSSE, WISCONSIN 54601
PHONE: 608.782.5844
FAX: 608.782.5844
E-MAIL: info@galileoconsulting.com

LIGHTING FIXTURE SCHEDULE												
TYPE	QTY	MANUFACTURER	CATALOG NUMBER	DESCRIPTION	MOUNTING			LAMPS/LIGHT SOURCE		WATTS/FIXTURE	REMARKS	
					VOLT	F	S	COLOR	LUMENS			TYPE
AD2		ACUITY	STAK-2X2-3000LM-80CRI-40K-COL-MINI-ZT-NLTAIR2	2'X2' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR	M.M.T	X		35-50	3040/50	LED 0-10VDC DIMMING	28-45	1
AD2S		ACUITY	STAK-2X2-3000LM-80CRI-40K-COL-MINI-ZT-NLTAIR2-APDT	2'X2' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR	M.M.T	X		35-50	3040/50	LED 0-10VDC DIMMING	28-45	1
AD2-E		ACUITY	STAK-2X2-3000LM-80CRI-40K-COL-MINI-ZT-NLTAIREM2	2'X2' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR, EMER	M.M.T	X		35-50	3040/50	LED 0-10VDC DIMMING	28-45	1
AD4		ACUITY	STAK-2X4-5000LM-80CRI-40K-COL-MINI-ZT-NLTAIR2	2'X4' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR	M.M.T	X		35-50	5060/70	LED 0-10VDC DIMMING	35-60	1
AD4S		ACUITY	STAK-2X4-5000LM-80CRI-40K-COL-MINI-ZT-NLTAIR2-APDT	2'X4' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR	M.M.T	X		35-50	5060/70	LED 0-10VDC DIMMING	35-60	1
AD4-E		ACUITY	STAK-2X4-5000LM-80CRI-40K-COL-MINI-ZT-NLTAIREM2	2'X4' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, ADJUSTABLE LUMEN, ADJUSTABLE COLOR TEMP., NLIGHT AIR, EMER	M.M.T	X		35-50	5060/70	LED 0-10VDC DIMMING	35-60	1
ADD		ACUITY	STAK-2X4-5000LM-80CRI-40K-COL-MINI-ZT-NLTAIR2-APDT	2'X4' LED LAYIN TROFFER, CURVED RIBBED CENTER BASKET, UNIVERSAL VOLTAGE, DIMMING, FIXED LUMEN, 4000K COLOR TEMP., NLIGHT AIR	M.M.T	X		4000K	6000	LED 0-10VDC DIMMING	45	1
C4		ACUITY	LDN4-4X2010-ARLS-TRU-MVOLT-G21-NLTAIR2	6" RECESSED DOWNLIGHT, 40K, 2000LUMENS, DOWNLIGHT, CLEAR TRIM COLOR, SEMI SPECULAR TRIM COLOR, WHITE FLANGE, 0-10V DIMMING, NLTAIR	M.M.T	X		4000K	2000	LED 0-10VDC DIMMING	20	2
D		TGS	ORBS-18-36-40-U-D1-BK-CM10	18"X18" SUSPENDED MOUNT, LED, DECORATIVE, BLACK FINISH	M.M.T	X		4000K	2,520	LED 0-10VDC DIMMING	36	2
TL8 H		TIMES SQUARE LIGHTING	JCR42-8040-B-120-48-DT2-010	LED TRACK HEAD, BLACK, QUANTITY OF 4	120		X	4000K	3500	LED 0-10VDC DIMMING	28	2
TL8 TK		TIMES SQUARE LIGHTING	DT8B	8'-0", TWO CIRCUIT, BLACK TRACK	120		X	4000K	3500	LED 0-10VDC DIMMING	28	2
X1/X2		ACUITY	LQM-BBS-RG-MVOLT-M6	LED EXT LIGHT, RED LETTERS, STAINLESS STEEL HOUSING, UNIVERSAL MONTING.	120/277		X			LED	<5	2
REMARKS:												
1 EQUALS ACCEPTED FOR THIS LIGHTING FIXTURE WITH PRIOR APPROVAL ONLY.												
2 EQUALS ACCEPTED FOR THIS LIGHTING FIXTURE.												

Panel- 'S', 125 AMP., 120/208VAC, 3-Phase, M.L.O. 22K

Space No.	Serves	C/B Size/Type	Load (KVA)	Load (KVA)	C/B Size/Type	Serves	Space No.
1	EXISTING	20/1			20/1	EXISTING	2
3	EXISTING	20/1			20/1	EXISTING	4
5	EXISTING	20/1			20/1	EXISTING	6
7	EXISTING	20/1			20/1	EXISTING	8
9	EXISTING	20/1			20/1	EXISTING	10
11	EXISTING	20/1			20/1	EXISTING	12
13	EXISTING	20/1			20/1	EXISTING	14
15	EXISTING	40/2			20/1	EXISTING	16
17	EXISTING	40/2			20/1	EXISTING	18
19	EXISTING	20/1			20/1	EXISTING	20
21	EXISTING	20/1			20/1	EXISTING	22
23	EXISTING	20/1			20/1	EXISTING	24
25	EXISTING	20/1			20/1	EXISTING	26
27	EXISTING	20/1			20/1	EXISTING	28
29	EXISTING	20/2			20/2	EXISTING	30
31	EXISTING	20/2			20/2	EXISTING	32
33	EXISTING	20/1			20/1	EXISTING	34
35	EXISTING	20/1			20/1	EXISTING	36
37	EXISTING	20/1			20/1	EXISTING	38
39	EXISTING	20/1			20/1	EXISTING	40
41	EXISTING	20/1			20/1	EXISTING	42

LIGHTING (KVA):			
RECEPTACLES (KVA):			
MOTOREQUIPMENT (KVA):			
TOTAL (KVA):		TOTAL AMP. :	
		(DIVERSITY) TOTAL (KVA):	



- Notes:
- Provide a 42 space panelboard.
 - Include with Alternate Bid #3

Project Title: WESTERN TECHNICAL COLLEGE
KUMM STUDENT UNION REMODEL

Project Location: 400 6th St. N.
La Crosse WI 54601

HSR Project Number: 25041
Project Date: FEBRUARY 2026
Drawn By: PLP

Key Plan:



No.	Description	Date
ADDENDUM # 2		02/24/26

Graphic Scale: VARIES
Last Update: 2/03/2026

E500